







Air Quality



AES Argentina
August 2026







Saavedra Station

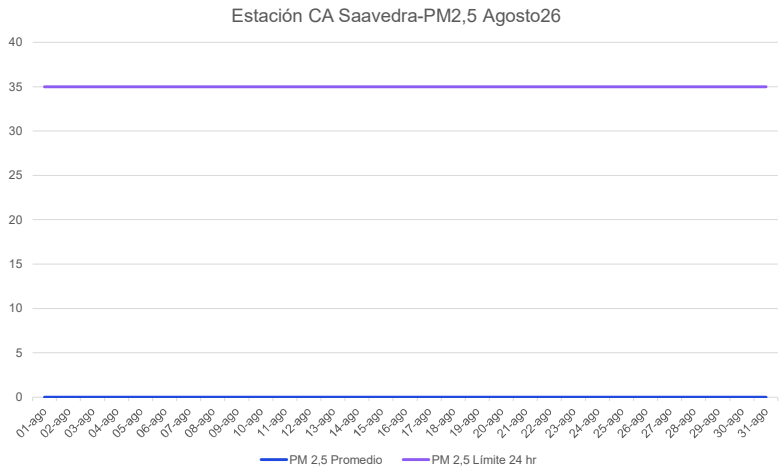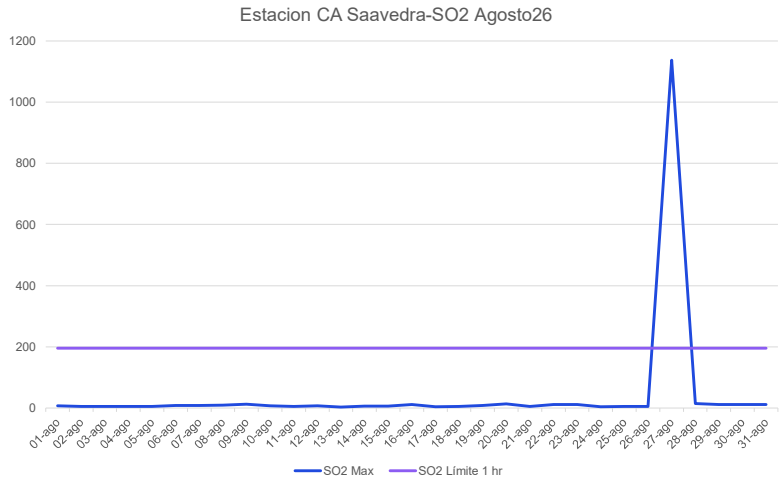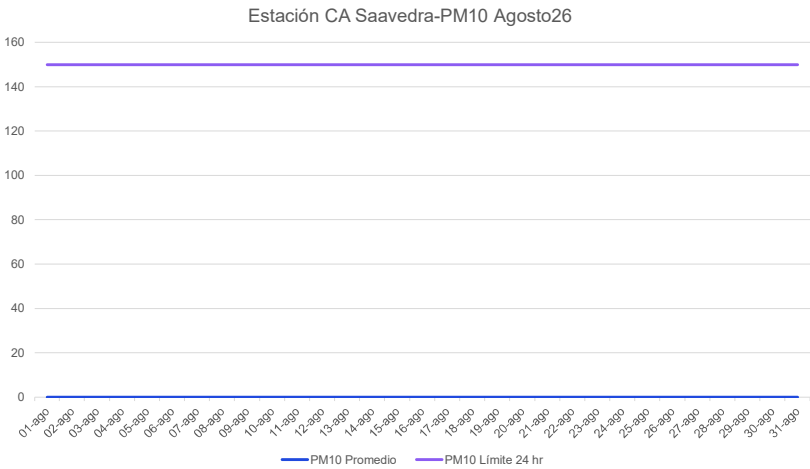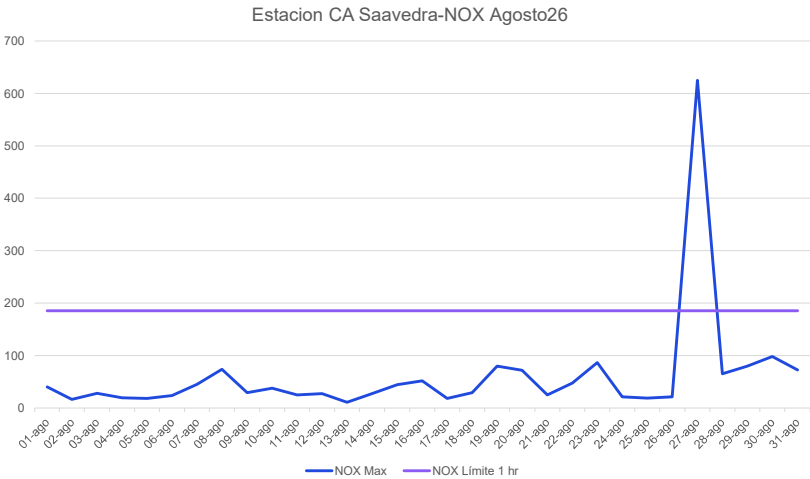





A value above the legal limit was observed (28/8), corresponding to the equipment calibration day. The PM10 and PM2.5 equipment was removed and is awaiting a replacement.

UTN Station

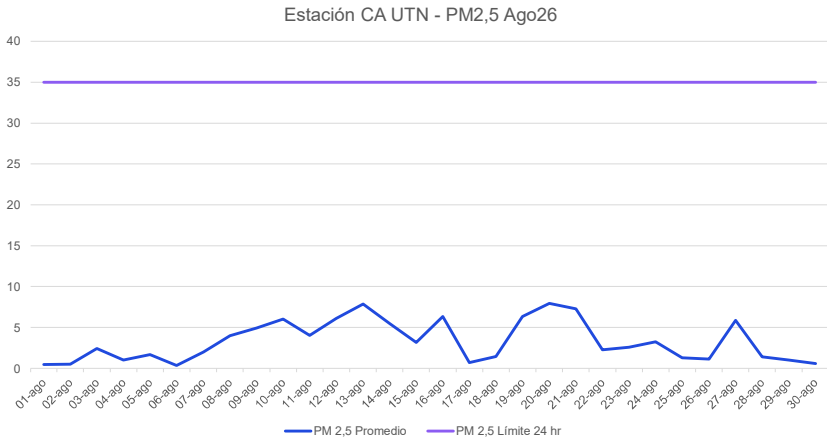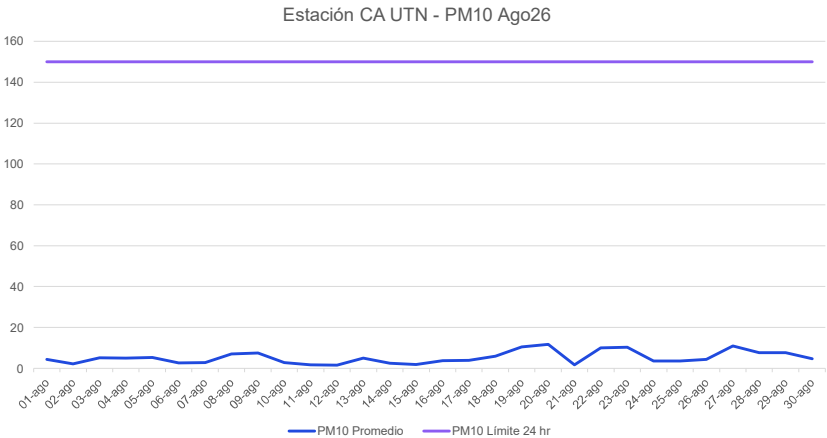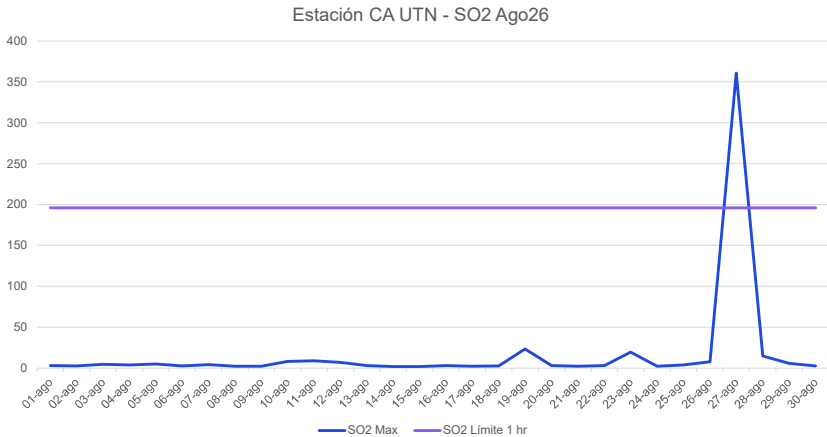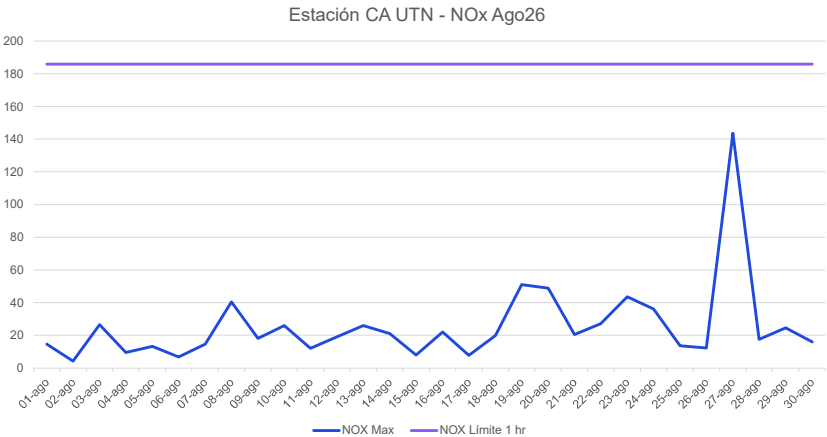

Only 1 day was observed above the legal limit of SO2 corresponding to the calibration day (27/08)

San Nicolas Thermal Powerplant

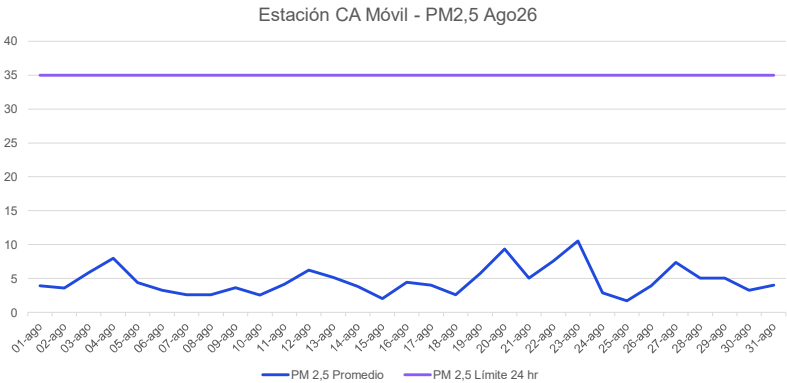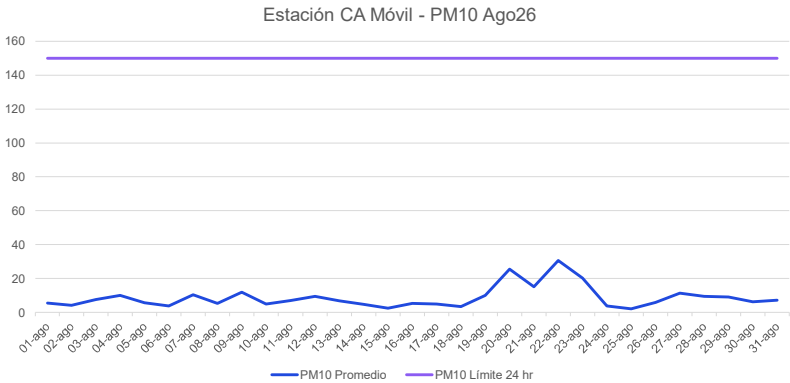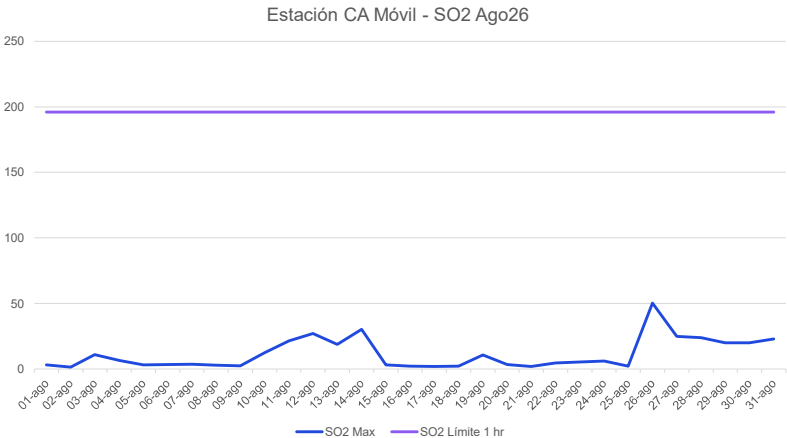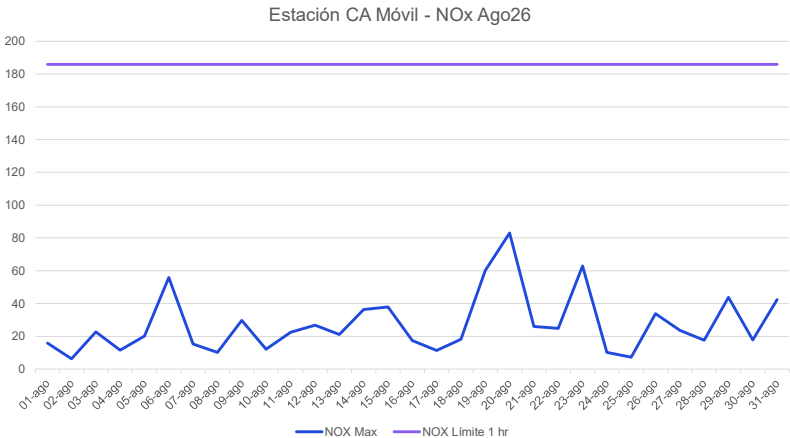

No days were observed above the legal limit.

